



390-02/3690-02


Place this manual with personnal responsible for maintenance of this valve



INSTALLATION



OPERATION



MAINTENANCE



CVCL 1 (2) 3 4 DIST CODE 002 SHEET 1 OF CATALOG NO. DRAWING NO. REV 01 - 28 - 10-03 - 06NEWPORT BEACH, CALIFORNIA В 390-02/3690-02 200699 TYPE OF VALVE AND MAIN FEATURES DESIGN ELECTRONIC INTERFACE PRESSURE DRAWN 03-05-02 ΑK 5 REDUCING VALVE (INTEGRAL CONTROLLER TYPE) CHK'D VL 3-06-02 APV'D СН 3-11-02 ¥ ¥ OPTIONAL FEATURES NOT FURNISHED BY CLA-VAL CO. 21821 (ECO ADDED OPTIONAL FEATURES P & OPTIONAL ITEM E (ECO 20335) മ D3 03-05 DATE INLET OUTLET ¥ Ы REMOVED REVISION RECORD - DO NOT REVISE MANUALLY REDUCING; 46860 ITEM NO. BASIC COMPONENTS QTY 100-01 HYTROL (390-02) MAIN VALVE (NED PRESSURE 1 1 100-20 HYTROL (3690-02) MAIN VALVE X58C RESTRICTION FITTING 1 PRODUCTION CRD33 ELECTRONIC PRESSURE REDUCING CONTROL ELECTRONIC CRD31 FOR OPTIONAL FEATURE SUFFIX ADDED TO CATALOG NUMBER SAD X46A FLOW CLEAN STRAINER VALVE POSITION INDICATOR WAS X101 1 RELEASED 1 В CK2 COCK (ISOLATION VALVE 3 STRAINER 1 С CV FLOW CONTROL (CLOSING) 1 E E CHECK VALVES WITH COCK D 1 X141 PRESSURE GAUGE 3 Ρ CV FLOW CONTROL (OPENING) THIS DRAWING IS THE PROPERTY OF CLA-VAL CO. AND SAME AND COPIES MADE THEREOF, IF ANY, SHALL BE RETURNED TO IT UPON DEMAND. DELIVERY AND DISCLOSURE HEREOF ARE SOLELY UPON CONDITION THAT THE SAME SHALL NOT BE USED, COPIED OR REPRODUCED, NOR SHALL THE SUBJECT HEREOF BE DISCLOSED IN ANY MANNER TO ANYONE FOR ANY PURPOSE, EXCEPT AS HEREIN AUTHORIZED, WITHOUT PRIOR WRITTEN APPROVAL OF CLA-VAL CO. THIS

DRAWING IS SUBMITTED CONFIDENTIALLY AND MAY NOT BE USED IN THE MANUFACTURE OF ANY MATERIAL OR PRODUCT OTHER THAN SUCH MATERIALS AND PRODUCTS FURNISHED TO CLA-VAL CO. WHETHER OR NOT THE EQUIPMENT OR INFORMATION SHOWN HEREON IS PATENTED OR OTHERWISE PROTECTED, FULL TITLE AND COPYRIGHTS, IF ANY, IN AND TO THIS DRAWING AND/OR INFORMATION DELIVERED OR SUBMITTED ARE FULLY RESERVED CLA-VAL CO."

						CVCL 1	② 3 4	DIST CO	DDE 002	SHE	ET 2 OF	. 3
				i CLA-	VAL CO.			CATALOG NO.	/3690-02	DRAWING NO.	00699	rev B
				ALVE AND MAIN FEATURE		NTERFAC	CE PRES	SSURE	,	DESIGN DRAWN CHK'D APV'D	AK VL CH	03-05-02 3-06-02 3-11-02
						0	PERATING	DATA				
			l.	PRESSURE SENSES MA PRESSURE PRESSURE PRESSURE MAINTAININ REDUCING CHANGE TH NOTE: RE	REDUCING F REDUCING C AIN VALVE O TENDS TO C TENDS TO C TO VARY AN IG A RELATIVE CONTROL (3 HE PRESSURI FER TO CLA- FORMATION R INTENANCE (CONTROL (UTLET PROLOSE CO OPEN CON ND THE M /ELY CON) ADJUST E REDUCII -VAL PRI REGARDINO	ŠEŚSURE NTROL (3) ITROL (3) IAIN VALV STANT OI MENT: A NG CONTI NTED FOR	CHANGES. AND A THIS (E MODUL JTLET PR CTUATE ROL SETT RM N—CRI ATION, O	. AN INC DECREAS CAUSES M .ATES (OF ESSURE. THE ELEC ING. D-32 FOF PERATION	REASE E IN C AIN VA PENS A PRESS TRONIC AND	IN OUT DUTLET ALVE CO' ND CLOS SURE C CONTR	VER SES) OL TO
			II.	SUFFIX A	FEATURE OP (FLOW CLEAN LEANING STR	N STRAINE	<u>ER)</u>	D IN THE	- MAIN VA	JVF IN	II FT BOI	ŊΥ
$\frac{\perp}{1}$	+	\dashv			CH PROTECTS							<i>,</i> 1
DATE	מאור			CK2 COCK	(ISOLATION \ S (B) ARE U PRESSURE. I	ISED TO I	SOLATE '	THE PILOT UST BE (T SYSTEM OPEN DUR	FROM RING NO	DRMAL	
à	5				 (CLOSING SP	EED CON.	TRAL)					
N RECORD - DO NOT REVISE MANUALLY DESCRIPTION				FLOW CONTURN THE SLOWER. SUFFIX DWHEN OUT (D2) OPEN	CLOSING SET TROL (C) CC ADJUSTING (CHECK VAL) LET PRESSUITS AND (D1) INTO THE M	NTROLS STEM CLO STEM CLO VES WITH RE IS HIG CLOSES.	THE CLOS DCKWISE <u>COCK):</u> HER THA THIS DI	TO MAKE N INLET F RECTS TH	THE MAIN PRESSURE JE HIGHER	, CHEC	E CLOSE CK VALVI	
N RECORD - DO NO	NOT THE PROPERTY OF THE PROPER			SUFFIX P PRESSURE	(PRESSURE (GAUGES (P) ID COVER CO	GAUGE):) PROVIDE	: PRESSU					

SUFFIX S (OPENING SPEED CONTROL)
FLOW CONTROL (S) CONTROLS THE OPENING SPEED OF THE MAIN VALVE.
TURN THE ADJUSTING STEM CLOCKWISE TO MAKE THE MAIN VALVE OPEN SLOWER.

CAD

SHEET

SEE

				CVCL 1 ② 3 4	DIST CODE 002	SHEET 3 OF	
			Ca Cla-Val Co.		CATALOG NO.	DRAWING NO.	REV
			TYPE OF VALVE AND MAIN FEATURES	NEW ON BENOIL ONLY	390-02/3690-02		В
				TEDE ACE DDECC	LIDE	DESIGN	
			ELECTRONIC IN			DRAWN AK	7 06 02
		П	REDUCING VALVE (INT	EGRAL CONTRO	LLER TYPE)	CHK'D VL APV'D CH	3-06-02 3-11-02
						AITU OII	3 11 02
		П		OPERATING DATA-(CONTINUED		
			-	or Environde Divine	30111110 <u>LB</u>		
			SUFFIX V (VALVE POSITIO	ON INDICATOR).			
			VALVE POSITION INDICAT	•	N MISHAL DOSITIO	N OF THE	
			MAIN VALVE STEM.	ON (V) DISPLATS A	Y VISUAL FUSITIO	IN OF THE	
			WAIN VALVE STEWI.				
			SUFFIX Y (Y-STRAINER)				
			A Y-PATTERN STRAINER	IS INSTALLED IN 7	THE PILOT SUPPL	Y LINE TO	
			PROTECT THE PILOT SYS	TEM FROM FOREIGN	N PARTICLES. TH	HE STRAINER	
			SCREEN MUST BE CLEAN	ED PERIODICALLY.			
			III. <u>CHECK LIST FOR PROPE</u>				
			() SYSTEM VALVES OPE				
			() AIR REMOVED FROM	THE MAIN VALVE (COVER AND PILO	I SYSTEM AT	ALL
			HIGH POINTS. () CK2 COCKS (B) OPE	N (OPTIONAL FEAT	IIRE)		
			() PERIODIC CLEANING			(OPTIONAL FE	ATURF)
			() CV FLOW (C) AND (S) OPEN AT LEAST	4 TURNS (OPTIC	ONAL FEATURE).
		П	() CORRECT VOLTAGE 1				
+	+	\dashv				(,
	DAIE						
	^						
ļ	4	Ш					
	≿ I						
ľ	_	Ш					
$\lfloor \rfloor$							
\exists							
WAN I							
띯							
윤							
힐	5						
8 8	-						
۔ اا	DESCRIP IION						
<u> </u>]						
8							
CAD REVISION RECORD — DO NOT REVISE MANUALLY							
ا ا ۾	_	:					
ੋ	114	<u> </u>					
	Į,	1 1					
	75	JI I					
ļ,	+	+					
	<u> </u>		HE PROPERTY OF CLA-VAL CO. AND SAME AND COPIES MADE THEREOF. IF	MIV CHAIL DE PERINARE ES LE LISE LIS	AID DELIVERY AND DIGGI COURT OF	ADE CALELY URAL COMPANY	AT THE CAME CO
OHIN I	MINA	15 IH	DE ENGERNIT OF GLA-VAL CO. AND SAME AND COPIES MADE THEREOF IF	MOVE SHALL BE RELUKNED (O.H. DPON DEMA	ONLY CITTUREST AND DISCLOSURE HEREOF	MRC SUITE FUNDING CONDITION TH	MI IDE SAME SHALL

3690-02

Electronic Actuated Pressure Reducing Valve



Schematic Diagram

ltem	ription

- 1 Hytrol (Main Valve)
- 2 X58C Restriction Fitting
- 3 CRD-33 Electronic Pressure Reducing Control

Optional Features

Item Description

A X46A Flow Clean Strainer

B CK2 (Isolation Valve)


C CV Flow Control (Closing)

D Check Valves with Isolation Valve

P X141 Pressure Gauge

S CV Flow Control (Opening)

X101 Valve Position Indicator



- Simplified Remote Valve Set-Point Control
- Isolated Input
- · Ideal for Pressure Management
- 12-24VDC Input Power
- Reverse Polarity Protection
- IP-68 (Submersible)

The Cla-Val Model 390-02/3690-02 Electronic Actuated Pressure Reducing Control Valve combines precise control of field proven Cla-Val hydraulic pilots and simple, remote valve control. The Cla-Val Model 390-02/3690-02 Pressure Reducing Valve automatically reduces a higher inlet pressure to a steady lower downstream pressure regardless of changing flow rate and/or varying inlet pressure. This valve is an accurate, pilot-operated regulator capable of holding downstream pressure to a pre-determined limit. The valve uses a CRD-33 pilot control, consisting of a hydraulic pilot and integral controller, that accepts a remote set-point command input and makes set-point adjustments to the pilot.


The recommended control method is simple remote set-point change from an RTU (Remote Telemetry Unit) to the CRD-33 where the 4-20 mA command signal is ranged to specific pressure range. Very accurate control can be achieved when span does not exceed 100 psi. Since the CRD-33 is preranged to the full spring range, some on-site calibration may be necessary when this control method is used. Free downloadable software is available from Cla-Val website for this purpose. The CRD-33 can also accommodate control systems where the RTU compares pressure transmitter signal to the remote set point command signal. The RTU adjusts the CRD-33 with 4-20 mA command signal containing an adequate deadband to prevent actuator dithering after the two signals agree.

Internal continuous electronic monitoring of actuator position results in virtually instantaneous position change with no backlash or dithering when control signal is changed. In the event of a power or control input failure, the CRD-33 pilot remains in hydraulic control virtually assuring system stability under changing conditions. If check feature ("D") is added, and pressure reversal occurs, the valve closes to prevent return flow.

Typical Applications

The Cla-Val 390 Series valves that maintain downstream pressure and require this pressure to be changed from a remote location. It can be an effective solution for lowering costs associated with "confined space" requirements by eliminating the need for entry in valve structure for set-point adjustment. It is also ideal for pressure management, and can be programmed to minimum night time and optimum daytime pressures. Optional profiler can be used to create custom correlation between pressure and flow information.

Flow information can also be provided from the main valve, see 133VF. Additional pilot controls, hydraulic and/or electronic, are also available to perform multiple functions to fit exact system requirements.

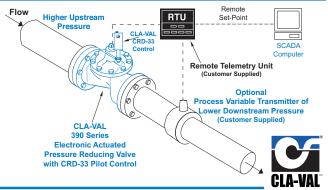

Model 390-02 (Uses Basic Valve Model 100-01)

Pressure Ratings (Recommended Maximum Pressure - psi)

Valve Body 8	Cover	Pressure Class										
valve body o	Cover	Fla	anged		Grooved	Threaded						
Grade	Material	ANSI Standards*	150 Class	300 Class	300 Class	End‡ Details						
ASTM A536	Ductile Iron	B16.42	250	400	400	400						
ASTM A216-WCB	Cast Steel	B16.5	285	400	400	400						
ASTM B62	Bronze	B16.24	225	400	400	400						

Note: * ANSI standards are for flange dimensions only. Flanged valves are available faced but not drilled.

‡ End Details machined to ANSI B2.1 specifications.

Valves for higher pressure are available; consult factory for details


Materials

Component	Standa	rd Material Combir	nations					
Body & Cover	Ductile Iron	Cast Steel	Bronze					
Available Sizes	1" - 36"	1" - 16"	1" - 16"					
Disc Retainer & Diaphragm Washer	Cast Iron	Cast Steel	Bronze					
Trim: Disc Guide,	Bı	onze is Standar	d					
Seat & Cover Bearing	Stain	ess Steel is Opt	ional					
Disc		Buna-N® Rubber						
Diaphragm	Nylon R	einforced Buna-N®	Rubber					
Stem, Nut & Spring	Stainless Steel							

For material options not listed, consult factory. Cla-Val manufactures valves in more than 50 different alloys.

B (Diameter) **Dimensions** (In inches) 100-01 Threaded & **Flanged** Χ С Inlet Outlet Ġ Ε GG GĢG Inlet DDD

-AA AAA



Note: The top two flange holes on valve size 36 are threaded to 1 1/2"-6 UNC.

Model 390-02 Dimensions (In Inches)

												1					1	
Valve Size (Inches)	1	1 1/4	1 1/2	2	2 1/2	3	4	6	8	10	12	14	16	18	20	24	30	36
A Threaded	7.25	7.25	7.25	9.38	11.00	12.50	_	_	_	_	_	_			_	_	_	_
AA 150 ANSI	_	_	8.50	9.38	11.00	12.00	15.00	20.00	25.38	29.75	34.00	39.00	41.38	46.00	52.00	61.50	63.00	76.00
AAA 300 ANSI	_	_	9.00	10.00	11.62	13.25	15.62	21.00	26.38	31.12	35.50	40.50	43.50	47.64	53.62	63.24	64.50	76.00
AAAA Grooved End	_	_	8.50	9.00	11.00	12.50	15.00	20.00	25.38	_	_	_	_	_	_	_	_	
B Dia.	5.62	5.62	5.62	6.62	8.00	9.12	11.50	15.75	20.00	23.62	28.00	32.75	35.50	41.50	45.00	53.16	56.00	66.00
C Max.	5.50	5.50	5.50	6.50	7.56	8.19	10.62	13.38	16.00	17.12	20.88	24.19	25.00	39.06	41.90	43.93	54.60	61.50
CC Max. Grooved End	_	_	4.75	5.75	6.88	7.25	9.31	12.12	14.62	_	_	_	_	_	_	_	_	_
D Threaded	3.25	3.25	3.25	4.75	5.50	6.25	_	_	_	_	_	_	_	_	_	_	_	_
DD 150 ANSI	_	_	4.00	4.75	5.50	6.00	7.50	10.00	12.69	14.88	17.00	19.50	20.81	_	_	30.75	_	
DDD 300 ANSI	_	_	4.25	5.00	5.88	6.38	7.88	10.50	13.25	15.56	17.75	20.25	21.62	_	_	31.62	_	_
DDDD Grooved End	_	_	_	4.75	_	6.00	7.50	_	_	_	_	_	_	_	_	_	_	_
E	1.12	1.12	1.12	1.50	1.69	2.06	3.19	4.31	5.31	9.25	10.75	12.62	15.50	12.95	15.00	17.75	21.31	24.56
EE Grooved End	_	_	2.00	2.50	2.88	3.12	4.25	6.00	7.56	_	_	_	_	_	_	_	_	_
F 150 ANSI	_	_	2.50	3.00	3.50	3.75	4.50	5.50	6.75	8.00	9.50	10.50	11.75	15.00	16.50	19.25	22.50	25.60
FF 300 ANSI	_	_	3.06	3.25	3.75	4.13	5.00	6.25	7.50	8.75	10.25	11.50	12.75	15.00	16.50	19.25	24.00	25.60
G Threaded	1.88	1.88	1.88	3.25	4.00	4.50	_	_	_	_	_	_	_	_	_	_	_	
GG 150 ANSI	_	_	4.00	3.25	4.00	4.00	5.00	6.00	8.00	8.62	13.75	14.88	15.69	_	_	22.06	_	_
GGG 300 ANSI	_	_	4.25	3.50	4.31	4.38	5.31	6.50	8.50	9.31	14.50	15.62	16.50	_	_	22.90	_	_
GGGG Grooved End	_	_	_	3.25	_	4.25	5.00	_	_	_	_	_	_	_	_	_	_	_
H NPT Body Tapping	.375	.375	.375	.375	.50	.50	.75	.75	1	1	1	1	1	1	1	1	2	2
J NPT Cover Center Plug	.25	.25	.25	.50	.50	.50	.75	.75	1	1	1.25	1.5	2	1.5	1.5	1.5	2	2
K NPT Cover Tapping	.375	.375	.375	.375	.50	.50	.75	.75	1	1	1	1	1	1	1	1	2	2
Stem Travel	0.4	0.4	0.4	0.6	0.7	8.0	1.1	1.7	2.3	2.8	3.4	4.0	4.5	5.1	5.63	6.75	7.5	8.5
Approx. Ship Wt. Lbs.	15	15	15	35	50	70	140	285	500	780	1165	1600	2265	2982	3900	6200	7703	11720
X Pilot System	11	11	11	13	14	15	17	29	31	33	36	40	40	43	47	68	79	85
Y Pilot System	9	9	9	9	10	11	12	20	22	24	26	29	30	32	34	39	40	45
Z Pilot System	9	9	9	9	10	11	12	20	22	24	26	29	30	32	34	39	42	47

Pressure Ratings (Recommended Maximum Pressure - psi)

Value Bady 8	Cover	Pressure Class								
Valve Body &	Cover	Flanged								
Grade	Material	ANSI Standards*	300 Class							
ASTM A536	Ductile Iron	B16.42	250	400						
ASTM A216-WCB	Cast Steel	B16.5	285	400						
ASTM B62	Bronze	B16.24	225	400						

Note: * ANSI standards are for flange dimensions only.

Flanged valves are available faced but not drilled.

Valves for higher pressure are available; consult factory for details


Materials


Component	Standard Material Combinations								
Body & Cover	Ductile Iron	Cast Steel	Bronze						
Available Sizes	3" - 48"	3" - 16"	3" - 16"						
Disc Retainer & Diaphragm Washer	Cast Iron	Cast Steel	Bronze						
Trim: Disc Guide,	Br	onze is Standar	d						
Seat & Cover Bearing	Stainl	ess Steel is Opt	ional						
Disc		Buna-N® Rubber							
Diaphragm	Nylon Reinforced Buna-N® Rubber								
Stem, Nut & Spring		Stainless Steel							

For material options not listed, consult factory.

Cla-Val manufactures valves in more than 50 different alloys.







Model 3690-02 Dimensions (In Inches)

Valve Size (Inches)	3	4	6	8	10	12	14	16	18	20	24	30	36	42	48
A 150 ANSI	10.25	13.88	17.75	21.38	26.00	30.00	34.25	35.00	42.12	48.00	48.00	63.25	65.00	76.00	94.50
AA 300 ANSI	11.00	14.50	18.62	22.38	27.38	31.50	35.75	36.62	43.63	49.62	49.75	63.75	67.00	76.00	94.50
B Dia.	6.62	9.12	11.50	15.75	20.00	23.62	27.47	28.00	35.44	35.44	35.44	53.19	56.00	66.00	66.00
C Max.	7.00	8.62	11.62	15.00	17.88	21.00	20.88	25.75	25.00	31.00	31.00	43.94	54.60	61.50	61.50
D 150 ANSI	_	6.94	8.88	10.69	CF*	_	_	_	_						
DD 300 ANSI	_	7.25	9.38	11.19	CF*	_	_	_	_						
E 150 ANSI	_	5.50	6.75	7.25	CF*	_	_	_	_						
EE 300 ANSI	_	5.81	7.25	7.75	CF*	_	_	_	_						
F 150 ANSI	3.75	4.50	5.50	6.75	8.00	9.50	11.00	11.75	15.88	14.56	17.00	19.88	25.50	28.00	31.50
FF 300 ANSI	4.12	5.00	6.25	7.50	8.75	10.25	11.50	12.75	15.88	16.06	19.00	22.00	27.50	28.00	31.50
H NPT Body Tapping	.375	.50	.75	.75	1	1	1	1	1	1	1	1	2	2	2
J NPT Cover Center Plug	.50	.50	.75	.75	1	1	1.25	1.25	2	2	2	2	2	2	2
K NPT Cover Tapping	.375	.50	.75	.75	1	1	1	1	1	1	1	1	2	2	2
Stem Travel	0.6	0.8	1.1	1.7	2.3	2.8	3.4	3.4	3.4	4.5	4.5	6.5	7.5	8.5	8.5
Approx. Ship Wt. Lbs.	45	85	195	330	625	900	1250	1380	1500	2551	2733	6500	8545	12450	13100
X Pilot System	13	15	27	30	33	36	36	41	40	46	55	68	79	85	86
Y Pilot System	10	11	18	20	22	24	26	26	30	30	30	39	40	45	47
Z Pilot System	10	11	18	20	22	24	26	26	30	30	30	39	42	47	49
+0 " = .															

*Consult Factory

Note: The top two flange holes on valve sizes 36 thru 48 are threaded to 1 1/2"-6 UNC.

390-02/3690-02 Purchase Specifications (CRD-33 supplement)

The Electronic Actuated Pressure Reducing Valve shall maintain a constant downstream pressure and shall be capable of remotely changing this pressure as directed by the hydraulic pressure reducing pilot and integral electronic actuator. The actuator shall provide the interface between remote telemetry and valve set point control. It shall compare a remote analog signal with an internal position signal in the actuator and adjust the hydraulic pilot spring mechanism to the new setting. The remote analog signal input shall be isolated and reverse polarity protected. A 4-20 mA actuator feedback signal shall be supplied as standard. A second command control input shall be available from dry contact switch closure for clockwise and counter clockwise rotation. The actuator shall be IP-68 rated for submersible service.

If power fails, the pilot shall continue to control the main valve to last set point. If remote set point signal is lost, the actuator shall be programmable to stay at last position or go to 4 mA or to 20 mA value of set point range. Default is last position. The actuator shall be ranged at the factory to the specific spring range in the pilot control. If other than the default settings are required, these changes shall be accomplished by using only the manufacturer's software and USB cable.

The Electronic Actuated Pressure Reducing Valve shall be Cla-Val Model 390-02/3690-02 as manufactured by Cla-Val, Newport Beach, CA.

390-02		100-0	1 Patter	n: Glob	e (G), A	ngle (A)	, End C	onnecti	ons: Th	readed	(T), Gro	oved (G	R), Flan	ged (F)	Indicate	Availab	le Sizes		
Valve	Inches	1	11/4	1½	2	2½	3	4	6	8	10	12	14	16	18	20	24	30	36
Selection	mm	25	32	40	50	65	80	100	150	200	250	300	350	400	450	500	600	750	900
Basic Valve	Pattern	G, A	G, A	G, A	G, A	G, A	G, A	G, A	G, A	G, A	G, A	G, A	G, A	G, A	G	G	G, A	G	G
100-01	End Detail	Т	Т	T, F, Gr*	T, F, Gr	T, F, Gr*	T, F, Gr	F, Gr	F, Gr*	F, Gr*	F	F	F	F	F	F	F	F	F
0	Maximum	55	93	125	210	300	460	800	1800	3100	4900	7000	8400	11000	14000	17000	25000	42000	50000
Suggested Flow (gpm)	Maximum Intermittent	68	120	160	260	370	580	990	2250	3900	6150	8720	10540	13700	17500	21700	31300	48000	62500
(95111)	Minimum	1	1	1	1	2	2	4	10	15	35	50	70	95	120	150	275	450	650
0	Maximum	3.5	6	8	13	19	29	50	113	195	309	442	530	694	883	1073	1577	2650	3150
Suggested Flow (Liters/Sec)	Maximum Intermittent	4.3	7.6	10	16	23	37	62	142	246	387	549	664	863	1104	1369	1972	3028	3940
(11013/060)	Minimum	.03	.03	.03	.06	.09	0.13	0.25	0.63	0.95	2.2	3.2	4.4	6.0	7.6	9.5	17.4	28.4	41.0
100-01 Series	s is the full i	nterna	l port	Hytrol.				For	Lowe	r Flov	vs Co	nsult	Factor	у			*Globe	e Groov	ed Only

3690-02				100-20 Pa	attern: G	lobe (G),	Angle (A)	, End Co	nnection	s: Flange	d (F) Indic	ate Availa	ble Sizes			
Valve	Inches	3	4	6	8	10	12	14	16	18	20	24	30	36	42	48
Selection	mm	80	100	150	200	250	300	350	400	450	500	600	750	900	1000	1200
Basic Valve	Pattern	G	G, A	G, A	G, A	G	G	G	G	G	G	G	G	G	G	G
100-20	End Detail	F	F	F	F	F	F	F	F	F	F	F	F	F	F	F
Suggested Flow	Maximum	260	580	1025	2300	4100	6400	9230	9230	16500	16500	16500	28000	33500	33500	33500
(gpm)	Minimum	1	2	4	10	15	35	50	50	95	95	95	275	450	450	450
Suggested Flow	Maximum	16	37	65	145	258	403	581	581	1040	1040	1040	1764	2115	2115	2115
(Liters/Sec)	Minimum	.06	.13	.25	.63	.95	2.2	3.2	3.2	6.0	6.0	6.0	17.4	28.4	41.0	41.0
100-20 Series	s is the redu	ced int	ernal p	ort size	version	of the	100-01	Series.			Fo	r Lowe	r Flows	Consu	It Facto	ry

We recommend providing adequate space around valve for maintenance work

CRD-33 Subassembly Specifications

Adjustment Ranges

2 to 30 psi

15 to 75 psi

20 to 105 psi

30 to 300 psi (factory ranged 40 to 140 psi)

End Connection

3/8" NPT

Temperature Range

Water: to 180°F

Materials

Pilot Control: Bronze ASTM B62 Trim: Stainless Steel Type 303 Rubber:Buna-N® Synthetic Rubber

Available with optional Stainless Steel or Monel materials.

Consult factory for details.

Note: Available with remote sensing control (specify CRA-33)

When Ordering, Please Specify

1. Catalog No. 390-02 or 3690-02

6. Trim Material

2. Valve Size

7. Adjustment Range

Pattern - Globe or Angle

. Adjustificht Hangt

4. Pressure Class

8. Desired Options

4. Pressure Class5. Threaded or Flanged

When Vertically Installed

130VC-3 (CRD-33) Actuator Specifications

Supply Power Input: 12V to 24V DC

No Load draw: 50 mA Max. Load draw: 250 mA

Remote Command Inputs: • 4-20mA, analog signal (isolated and reverse-polarity

protected)

Dry contact closure (CW/CCW)

Position Feedback Signal: 4-20 mA

Alarm Output: Dry-contact closure (High/Low)

Speed of Rotation: Adjustable On/Off time, max 6 rpm

Diagnostic: LED Indicator

Loss of Power: Actuator will remain in last commanded

position.

Loss of Signal Position: Programmable - 4 mA, Last, or 20 mA

Electrical Connections: Single, 30 feet of permanently attached

cable with color-coded power supply

and signal wires

Mechanical Specifications:

Environmental

Protection Class: IP-68 (Temporary submersible) Ambient Temperature: 15° to 150° F (-10° to 65° C)

Materials

Electronics Enclosure: Anodized Aluminum

Mechanical Housing: Bronze

Coupling Assembly: Stainless Steel

Gear Train: Stainless Steel, permanently lubricated