



550-01


Place this manual with personnal responsible for maintenance of this valve



### INSTALLATION



## **OPERATION**



### **MAINTENANCE**



CVCL 1 ② 3 4 DIST. CODE 002 SHEET 1 OF CATALOG NO. DRAWING NO. NEWPORT BEACH, CALIFORNIA 550-01/6550-01 203909 Α -23-DESIGN PRESSURE RELIEF VALVE 10-06-03 DRAWN AK 7 CHK'D VΙ 10-06-03 (EQUIPPED WITH CLOSING SPEED CONTROL) APV'D CH 10-06-03 NOT FURNISHED BY CLA-VAL CO. OPTIONAL FEATURES 497 REMOTE SENSING CLOSING) CONTROL 2 FLOW B2 OPTION ADDED B1 B1 D3 DRAIN TO **ATMOSPHERE** 10 - 06DATE INLET OUTLET ¥ ¥ В REVISE MANUALLY ITEM NO. BASIC COMPONENTS (NED 100-46 HYTROL (550-01) MAIN VALVE 20158) 1 100-44 HYTROL (6550-01) MAIN VALVE - DO NOT X42N-2 STRAINER & NEEDLE VALVE 1 PRODUCTION CRL PRESSURE RELIEF CONTROL ECO RECORD REVISION ADDED TO CATALOG NUMBER OPTIONAL FEATURE SUFFIX В CK2 COCK (ISOLATION VALVES) С CV FLOW CONTROL (CLOSING) 1 D CHECK VALVES WITH COCK 1 REMOTE PILOT SENSING DRAIN TO ATMOSPHERE CV FLOW CONTROL (OPENING)

CVCL 1 ② 3 4 DIST. CODE 002 SHEET 2 OF 3 DRAWING NO. CATALOG NO. REV. NEWPORT BEACH, CALIFORNIA 550-01/6550-01 203909 Α DESIGN PRESSURE RELIEF VALVE 10-06-03 DRAWN ΑK CHK'D VI 10-06-03 (EQUIPPED WITH CLOSING SPEED CONTROL) APV'D CH 10-06-03 **OPERATING DATA** PRESSURE RELIEF FEATURE: PRESSURE RELIEF CONTROL (3) IS A NORMALLY CLOSED CONTROL THAT RESPONDS TO MAIN VALVE INLET PRESSURE CHANGES. AN INCREASE IN INLET PRESSURE TENDS TO OPEN CONTROL (3) AND A DECREASE IN INLET PRESSURE TENDS TO CLOSE CONTROL (3). THIS CAUSES MAIN VALVE COVER PRESSURE TO VARY AND THE MAIN VALVE MODULATES (OPENS AND CLOSES) MAINTAINING A RELATIVELY CONSTANT PRESSURE AT THE MAIN VALVE WHEN INLET PRESSURE IS LOWER THAN THE SET POINT OF CONTROL (3), CONTROL (3) CLOSES. THIS PRESSURIZES THE MAIN VALVE COVER CHAMBER AND THE MAIN VALVE CLOSES. PRESSURE RELIEF CONTROL (3) ADJUSTMENT: TURN THE ADJUSTING SCREW CLOCKWISE TO INCREASE THE SETTING. II. CLOSING SPEED CONTROL: NEEDLE VALVE (2) CONTROLS THE CLOSING SPEED OF THE MAIN VALVE. TURN THE ADJUSTING STEM CLOCKWISE TO MAKE THE MAIN VALVE CLOSE SLOWER. DO NOT CLOSE VALVE (2) COMPLETELY OR THE MAIN VALVE WILL NOT CLOSE. (SUGGESTED INITIAL SETTING OF NEEDLE VALVE IS 1/4 TO 1/2 TURN OPEN.) DATE III. OPTIONAL FEATURE OPERATING DATA: Æ SUFFIX B (ISOLATION VALVES) CK2 COCKS (B1) AND (B2) ARE USED TO ISOLATE THE PILOT SYSTEM FROM MAIN LINE PRESSURE. THESE VALVES MUST BE OPEN DURING NORMAL OPERATION. REVISE MANUALLY SUFFIX C (CLOSING SPEED CONTROL) FLOW CONTROL (C) CONTROLS THE CLOSING SPEED OF THE MAIN VALVE. TURN THE ADJUSTING STEM CLOCKWISE TO MAKE THE MAIN VALVE CLOSE SLOWER. DO NOT SUFFIX D (CHECK VALVES WITH COCK):

WHEN OUTLET PRESSURE IS HIGHER THAN INLET PRESSURE, CHECK VALVE (D2) OPENS AND (D1) CLOSES. THIS DIRECTS THE HIGHER OUTLET PRESSURE INTO THE MAIN VALVE COVER AND THE MAIN VALVE CLOSES.

SUFFIX F (REMOTE PILOT SENSING)

RECORD

REVISION

S

SHEET

REMOTE SENSING PRESSURE IS OBTAINED FROM A POINT UPSTREAM OF THE MAIN VALVE INLET. [SENSING PRESSURE IS OBTAINED FROM THE MAIN VALVE INLET IF SUFFIX (F) IS NOT SPECIFIED].

					_					(	CVCL	1 ②	3 4		IST. CODE 002		HEET 3 OF	<del>.</del> 3	
					i	21 <i>E</i>	1-1	<i>I</i> AL	CI		NEWPORT	BEACH, CA	JFORNIA		nlog no. 50—01/6550—0	DRAWING	NO. 203909		REV.
			TYPE C	F VA	ALVE AND				U	<u>.</u>		•		100	0-01/0330-0	DESIGN	203909	Т	A
								PR	RESS	SURE	E RE	LIEF	VALVE	=		DRAWN	AK	10	0-06-03
			41			(E	QUIF								CONTROL)	CHK'D	VL	10	0-06-03
			<u> </u>													APV'D	СН	10	0-06-03
			IV	··	PILO SYS SUF SUF FLO TUF SLO	OT S STEM FFIX W C RN T WER SYS	SYSTI I DR. (H) S ((CONTI THE / S. LIST	EM D AIN L IS N OPEN ROL ADJU	PRAIN LINE OT S ING S (S) ( STING	ERIC I LIN IS C SPEC SPEE CON' G ST	DRA JE IS CONNIC CIFIED  ED CO TROLS TEM (  R OPI	IN) DISCHECTED .]  ONTRO S THE CLOCK  ERATIO	TO THE  OPENIN WISE TO  ON:  AM AND	TC E N NG N M	NUED  ATMOSPHER MAIN VALVE C  SPEED OF TH MAKE THE MAI  OWNSTREAM. VER AND PILO	DUTLĒT IE MAI N VAL	T BOSS IF IN VALVE. LVE OPEN		
			_		( )	HIG CK2 PEF	H PO 2 CO RIODI	OINTS OCKS C CL	S. (B1) EANI	, (B NG	2) & OF S	(D3) TRAIN	OPEN ( ER (2)	(OF IS	PTIONAL FEATI RECOMMENDE TURNS (OPTION	URE). D.			-
	DATE				` ,			`	,	` ,					,		ŕ		
	B⊀																		
CAD REVISION RECORD — DO NOT REVISE MANUALLY		SEE SHEET 1																	



## 316SS Hytrol Valve




- All 316 Stainless Steel
- Reduced Cavitation Design
- **Drip-Tight, Positive Sealing Action**
- Service Without Removal From Line
- **Every Valve Factory Tested**
- **Three-Year Warranty**

The Cla-Val Model 100-44 Hytrol 316SS Valve is a hydraulically operated, diaphragm actuated, globe pattern valve with all 316 Stainless Steel metal parts. Specially designed 316 Stainless Steel removable slip-on flanges provide 150 or 300 ANSI class flange connections that meet ANSI and ISO standards. This valve is ideal for control valve applications where fluid compatibility is often a problem. The standard Electropolish finish on the 316 Stainless Steel parts offers extreme corrosion resistance to many industrial fluids such as seawater, high alkyl or high acid concentrations or other aggressive or corrosive fluids.


The Model 100-44 Hytrol consists of these major components: body, flanges, diaphragm assembly and cover. The diaphragm assembly is the only moving part and is guided top and bottom by a precision-machined stem. A non-wicking diaphragm of nylon fabric reinforced, synthetic rubber creates the control chamber for the valve. A resilient, synthetic rubber disc forms a drip-tight seal, with the renewable seat, when pressure is applied to the control chamber. The rugged simplicity of design and packless construction assures a long life of dependable, trouble-free operation. Smooth flow passages and fully guided diaphragm assembly assure optimum control, when used in piping systems requiring remote control, pressure regulation, solenoid operation, rate of flow control or check valve operation.

#### **Principle of Operation**




#### **Full Open Operation**

When pressure in the cover chamber is relieved to a zone of lower pressure, the line pressure at the valve inlet opens the valve, allowing full flow.



#### **Tight Closing Operation**

When pressure from the valve inlet is applied to the cover chamber, the valve closes drip-tight.



#### **Modulating Action**

The valve holds any intermediate position when operating pressure is equal above and below the diaphragm. Using a Cla-Val "Modulating" Control will allow the valve to automatically compensate for line pressure changes.

#### **Specifications**

#### **Sizes**

Globe (inch):

2", 2½", 3", 4", 6", 8", 10", 12"

#### **End Detail**

Slip-on Two Piece Flange Dimensions Per ANSI B16.5

#### **Pressure Rating**

ANSI Class 150: Maximum 285 psi ANSI Class 300: Maximum 400 psi

Higher Pressure Available Please Contact Factory

#### **Operating Temperature**

Fluids Compatible with Valve Materials -40° to 180° F (-40° to 82° C)


#### **Materials**


Body, Cover, Trim,
Diaphragm Assembly,
Flanges, and Fasteners
316 Series
Stainless Steel
Electropolished
Disc:


Buna-N® Rubber\* Diaphragm:

Nylon Fabric Reinforced Synthetic Buna-N® Rubber\*

**Note:** 100-44 valve uses the same internal parts as the basic Cla-Val standard main reduced internal port 100-20 Hytrol.







#### **Dimensions** (in inches)

Size (Inches)	2	2 ½	3	4	6	8	10	12
Size (mm)	50	65	80	100	150	200	250	300
A 150 ANSI	9.06	11.42	12.20	13.78	18.90	23.62	28.74	33.46
AA 300 ANSI	9.06	11.42	12.20	13.78	18.90	23.62	28.74	33.46
В	5.70	8.06	6.69	9.25	11.61	15.75	20.08	23.62
С	.89	.89	.93	.93	1.02	1.15	1.15	1.25
CC 300 ANSI	.96	.96	1.00	1.00	1.10	1.15	1.46	1.50
D	6.50	7.95	8.20	10.12	13.32	16.39	19.12	20.95
E	3.05	3.54	3.74	4.53	5.61	6.79	7.97	9.55
EE 300 ANSI	3.25	3.75	4.13	5.01	6.30	7.48	8.76	10.24
F	.71	.71	.71	.71	.91	.87	1.02	1.02
FF 300 ANSI	.71	.75	.87	.87	.87	1.03	1.16	1.34
G	4.75	5.50	6.00	7.50	9.50	11.75	14.25	17.00
e GG 300 ANSI	5.00	5.88	6.62	7.88	10.62	13.00	15.25	17.72
Flange Bolts (150 Class)	4	4	4	8	8	8	12	12
Flange Bolts (300 Class)	8	8	8	8	12	12	16	16
Approx. Ship Wt. Lbs.	25	40	40	75	160	290	419	728
Approx. Ship Wt. Kgs.	11.4	19	19	35	73	132	190	330

#### **Reduced Port Functional Data**

Size (Inches)	Cv (gpm)*	Cv (l/s)**					
2	38	9					
2½	50	12					
3	67	16					
4	138	33					
6	242	58					
8	555	133					
10	923	222					
12	1492	359					
*Cv = gpm flo	*Cv = gpm flow at 1 psi drop						





## When Ordering Please Specify:

- 1. Catalog No. 100-44
- 2. Valve Size
- 3. Fluid Being Handled
- 4. Fluid Temperature
- 5. Inlet Pressure Range
- 6. Outlet Pressure Range
- 7. Maximum and Minimum Differential Pressure
- 8. Flow Rate Range

PO Box 1325 Newport Beach CA 92659-0325 • Phone: 949-722-4800 Fax: 949-548-5441 • Web Site: cla-val.com • E-mail: claval@cla-val.com

CLA-VAL CANADA
4687 Christie Drive
Beamsville, Ontario
Canada LOR 184
Phone: 905-563-4963
Fax: 905-563-4040
E-Mail: sales@cla-val.ca

CLA-VAL EUROPE Chemin des Mésanges 1 CH-1032 Romanel/ Lausanne, Switzerland Phone: 41-21-643-15-55 Fax: 41-21-643-15-50 E-Mail: cla-val@cla-val.ch

CLA-VAL UK
Dainton House, Goods Station Road
GB - Tunbridge Wells
Kent TN1 2 DH England
Phone: 44-1892-514-400
Fax: 44-1892-543-423
E-Mail: info@cla-val.co.uk

Represented By:




<sup>\*</sup>Contact Factory for Other Disc or Diaphragm Materials



## X42N-2

## Strainer and Needle Valve Assembly

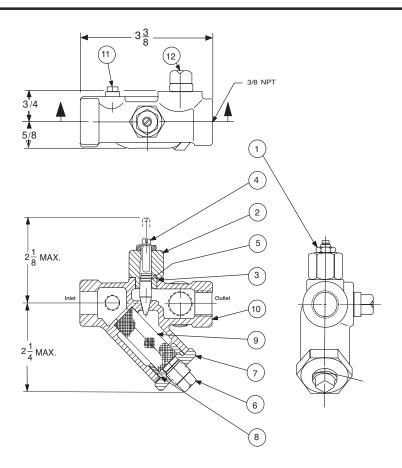

#### When ordering parts, please specify:

- · All nameplate data
- Item Number
- Description

Size	Stock Number
3/8" x 3/8"	68372C

ITEM	DESCRIPTION	MATERIAL	PART NO.
1	Jam Nut - Hex	Sil Brz	6779806G
2	Bonnet	S.S.	67910A
3	O-Ring - Bonnet	Syn Rub	00713J
4	Stem	S.S.	67907G
5	O-Ring - Stem	Syn Rub	00708J
6	Plug - Pipe 1/4"	Bre.	6784702A
7	Strainer Plug	303	67911J
8	O-Ring - Plug	NBR	00751J
9	Screen	Monel	68373A
10	Body	Rd Brs	67905A
11	Plut - Pipe 1/8	Brass	6784701C
12	Plug - Pipe 3/8	Brass	67660-03F



## - MODEL - CRL

## **Pressure Relief Control**

#### **DESCRIPTION**

The CRL Pressure Relief Control is a direct acting, spring loaded, diaphragm type relief valve. It may be used as a self-contained valve or as a pilot control for a Cla-Val Main valve. It opens and closes within very close pressure limits.

#### INSTALLATION

The CRL Pressure Relief Control may be installed in any position. The control body (7) has one inlet and one outlet port with a side pipe plug (24) at each port. These plugs are used for control connections or gauge applications. The inlet in the power unit body (6) is the sensing line port. A flow arrow is marked on the body casting.

#### **OPERATION**

The CRL Pressure Relief Control is normally held closed by the force of the compression spring above the diaphragm; control pressure is applied under the diaphragm.

When the controlling pressure exceeds the spring setting, the disc is lifted off its seat, permitting flow through the control.

When controlling pressure drops below spring setting, the spring returns the control to its normally closed position.

#### **ADJUSTMENT PROCEDURE**

The CRL Pressure Relief Control can be adjusted to provide a relief setting at any point within the range found on the nameplate.

Pressure adjustment is made by turning the adjustment screw (9) to vary the spring pressure on the diaphragm. Turning the adjustment screw clockwise increases the pressure required to open the valve. Counterclockwise decreases the pressure required to open the valve.

When pressure adjustments are complete the jam nut (10) should be tightened and the protective cap (1) replaced. If there is a problem of tampering, lock wire holes have been provided in cap and cover. Wire the cap to cover and secure with lead seal.

#### DISASSEMBLY

The CRL Pressure Relief Control does not need to be removed from the line for disassembly. Make sure that pressure shut down is accompanied prior to disassembly. If the CRL is removed from the line for disassembly be sure to use a soft jawed vise to hold body during work.

Refer to Parts List Drawing for Item Numbers.

- Remove cap (1), loosen jam nut (10) and turn adjusting screw counterclockwise until spring tension is relieved.
- Remove the eight screws (4) holding the cover (3) and powerunit body (6). Hold the cover and powerunit together and place on a suitable work surface. See NOTE under REASSEMBLY.
- Remove the cover (3) from powerunit body (6). The spring (12) and two spring guides (11).
- Remove nut (13) from stem (19) and slide off the belleville washer (14), the upper diaphragm washer (15) and the diaphragm (16).
- Pull the stem (19) with the disc retainer assembly (21) through the bottom of powerunit. The lower diaphragm washer (17) will slide off
- Remove jam nut (23) and disc retainer assembly (21) from stem. Use soft jawed pliers or vise to hold stem. The polished surface of stem must not be scored or scratched.
- The seat (22) need not be removed unless it is damaged. If removal is necessary use proper size socket wrench and turn counterclock

Note: Some models have an integral seat in the body (7).

#### INSPECTION

Inspect all parts for damage, or evidence of cross threading. Check diaphragm and disc retainer assembly for tears, abrasions or other damage. Check all metal parts for damage, corrosion or excessive wear.

#### REPAIR AND REPLACEMENT

Minor nicks and scratches may be polished out using 400 grit wet or dry sandpaper fine emery or crocus cloth. Replace all O-rings and any dam-

When ordering replacement parts, be sure to specify parts list item number and all nameplate data.

#### REASSEMBLY

In general, reassembly is the reverse of disassembly. However, the following steps should be observed:

- Lubricate the O-Ring (18) with a small amount of a good grade of waterproof grease, (Dow Corning 44 medium grade or equal). Use grease sparingly and install O-ring in powerunit body (6).
- 2. Install stem (19) in powerunit body (6). Use a rotating motion with minimum pressure to let stem pass through O-ring.

Do Not Cut O-Ring.


- 3. Install O-ring (5) at top of stem (19). Place lower diaphragm washer (17) on the stem with the serrated side up. Position diaphragm (16), upper diaphragm washer (15), with serration down, and belleville washer (14) with concave side down.
- 4. Position powerunit body (6) as shown on parts list drawing (top view).
- 5. Continue reassembly as outlined in disassembly steps 1 through 3.


Note: Item (4) Screw will have a quantity of 8 for the 0-75 and 20-200psi design and a quantity of 4 for the 100-300psi design. Item (25) Screw is used on the 100-300psi design only. Install item (25), before item (4) for preload of item (12) spring.

SYMPTOM	PROBABLE CAUSE	REMEDY
Fails to open.	Controlling pressure too low.	Back off adjusting screw until valve opens.
Fails to open with spring compression removed.	Mechanical obstruction, corrosion, scale build-up on stem.	Disassemble, locate, and remove obstruction, scale.
Leakage from cover vent hole when con- trolling pressure is applied.	Diaphragm Damage	Disassembly replace damaged diaphragm.
	Loose diaphragm assembly.	Tighten upper diaphragm washer.
Fails to close.	No spring compression.	Re-set pressure adjustment.
Fails to close with spring compressed.	Mechanical obstruction.	Disassemble, locate and remove obstruction.



## 1/2" & 3/4" PRESSURE RELIEF CONTROL (Bronze Body with 303SS Trim)

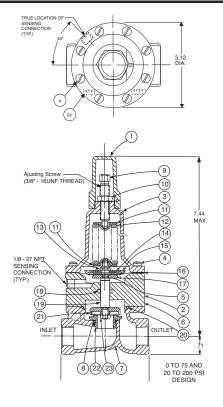

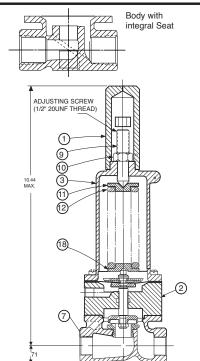

100 To 300 psi Design

SIZE	SPR	RING	PART NUMBER			
1/2"	0-75	PSI	7922201E			
1/2"	20-10	5 PSI	7922205F			
1/2"	20-20	0 PSI	7922202C			
1/2"	100-30	00 PSI	8280901D			
3/4"	0-75	PSI	7922901K			
3/4"	20-10	5 PSI	7922903F			
3/4"	20-20	0 PSI	7922902H			
3/4"	100-30	00 PSI	8600501E			
For 2	For 250-600 PSI Contact Factory					
CF Range	· <b>-</b>	FC	X. INCREASE DR EACH VISE TURN OF			

CRL Range PSI	APPROX. INCREASE FOR EACH CLOCKWISE TURN OF ADJUSTING SCREW
0 to 75	8.5 PSI
20 to 105	12.5 PSI
20 to 200	28.0 PSI
100 to 300	18.0 PSI

#### When ordering parts please specify:

- 1. All Nameplate Data
- 2. Item Part Number
- 3. Item Description

Item	Description	Material	Part Number	Part Number	Part Number	Part Number
			0-75	20-105	20-200	100-300
1	Cap	Plastic	67628J	67628J	67628J	1257601D
2	Nameplate	Brass				
3	Cover	Bronze	C2544K	C2544K	C2544K	44587E
4*	Screw Fil. Hd. 10-32 x 1.88 (Qty 8)	303 SS	6757867E	6757867E	6757867E	6757867E
5*	O-Ring	Rubber	00902H	00902H	00902H	00902H
6	Body, Powerunit	Bronze	7920504D	7920504D	7920504D	7920504D
7	1/2" Body	Bronze	C7928K	C7928K	C7928K	C7928K
	3/4" Body	Bronze	C9083B	C9083B	C9083B	C9083B
8*	O-Ring, Seat	Rubber	00718H	00718H	00718H	00718H
9	Screw, Adjusting	Brass	7188201D	7188201D	7188201D	82811B
10	Nut Hex (Locking)	303 SS	6780106J	6780106J	6780106J	6780606H
11	Guide, Spring	303 SS	71881H	71881H	71881H	1630301J
12	Spring	CHR/VAN	71884B	20632101E	71885J	1630201A
13	Nut, Stem Upper	Bronze	73034B	73034B	73034B	73034B
14	Washer, Belleville	Steel	7055007E	7055007E	7055007E	7055007E
15	Washer, Diaphragm (upper)	303 SS	71891G	71891G	71891G	71891G
16*	Diaphragm	Rubber	C1505B	C1505B	C1505B	C1505B
17	Washer, Diaphragm (lower)	303 SS	45871B	45871B	45871B	45871B
18*	O-Ring, Stem	Rubber	00746J	00746J	00746J	00746J
19	Stem	303 SS	8982401F	8982401F	8982401F	8982401F
20*	O-Ring, Body	Rubber	00767E	00767E	00767E	00767E
21*	Retainer Assembly, Disc	303 SS	C9158B	C9158B	C9158B	C9158B
22	Seat	303Rub	62187A	62187A	62187A	62187A
23	Nut, Hex, Stem, Lower	Bronze	6779806G	6779806G	6779806G	6779806G
24	Pipe Plug	Bronze	6784701C	6784701C	6784701C	6784701C
	FACTORY SET POINT	-	50 PSI	60 PSI	60 PSI	100 PSI
	REPAIR KIT*		9170007A	9170007A	9170007A	9170007A



## **Regulator Spring Color Coding Chart**

Dwg#47117

\*THESE FIGURES ARE ONLY APPROXIMATE. FINAL ADJUSTMENTS SHOULD BE MADE WITH A PRESSURE GAGE.

WIRE SIZE	Spring Number	Color	WIRE MATERIAL	CATALOG NUMBER	PSI RANGE	*PSI PER TURN
.080 DIA.	C0492D	BLUE	S.S.	CDB-7	0-7	.75
.000 DIA.	C0492D	DLUL	3.3.	CRL-5A	0-7	.75
.018 DIA.	82575C		S.S.	CRD	1.9-6.5	.61
.010 DIA.	023730		0.0.	CRD-10A	1.9-6.5	.49
.116 DIA.	81594E		S.S.	CRD	2-30	3.0
	010012		0.0.	CRD-10A	2-30	2.4
.120 DIA.	V5654J	GREEN	CHR VAN	CRL-5A	5-25	4.0
	700010	GITELIT	01111 17111	CRD	10-40	4.0
				CDB-7	10-60	12.0
.162 DIA.	32447F	NATURAL	S.S.	CRL-5A	10-60	12.0
				CRL-13	10-60	12.0
				CDB-7	20-80	14.5
.162 DIA.	V5695B	YELLOW	MUSIC WIRE	CRL-5A	20-80	14.5
				CRL-13	20-80	14.5
				CDB-7	50-150	29.5
.207 DIA.	C1124B	CAD PLT	MUSIC WIRE	CRL-13	50-150	29.5
				CRL-5A	50-150	29.5
				CDB-7	65-180	44.0
.225 DIA.	V6515A	RED	MUSIC WIRE	CRL-13	65-180	44.0
				CRL-5A	65-180	44.0
				CRL	0-75	8.5
.115 X .218	71884B	RED	CHR VAN	CRD	15-75	9.0
				CRD-10A	15-75	7.2
				CRL	20-200	28.0
.118 X .225	71885J	GREEN	CHR VAN	CRD	30-300	27.0
				CRD-10A	30-300	22.4
.225 X .295	1630201A	CAD PLT	CHR VAN	CRL	100-300	18.00
.225 X .255	100020174	OADTE	OTHE VAIV	CRL-5A	100-300	18.00
				CRA-18	200-450	17.0
.440 X .219	48211H	CAD PLT	STEEL	CRD-22	200-450	17.0
				CRL-4A	100-450	17.0
.187	20632101E	BLACK	316 SST	CRD	20-105	13.0
.107	20032101E	BLACK	310 331	CRL	20-105	13.0
WIRE SIZE	SPRING NUMBER	Color	WIRE MATERIAL	CATALOG NUMBER	FEET RANGE	*FEET PER TURN
000 DIA	C0400D	DLUE	0.0	CRA	4.5-15	.82
.080 DIA.	C0492D	BLUE	S.S.	CRD-2	4.5-15	.82
	87719B	EPOXY	CHROME SILICON	CDS-5		
	1 SPRING	COATED			5-40	1.0
075 514	2 SPRING				30-80	2.0
.375 DIA.	3 SPRING				70-120	3.0
	4 SPRING				110-120	4.0
	5 SPRING				150-200	5.0
.072 DIA.	V5097A		302SS	CVC	1-17	.7
.0, 2 0, 1.	2933502H	EPOXY	CHROME SILICON		,	.,
	1 SPRING	COATED	OI INDIVIE SILICUN	0D3-0A	5-40	75
		COATED				.75
.375 DIA.	2 SPRING				30-80	1.50
	3 SPRING				70-120	2.20
	4 SPRING				110-160	3.00
	5 SPRING				150-200	3.70

THE FOLLOWING CONTROL & SPRING P/N#'S WERE REMOVED, 32656B, 31554K, 44591G, V65695B, & V5695B. ADDED CRL-13, CRL-5A, CRA, CRA-10A, CHANGED SPRING RANGES TO MATCH CURRENT CONTROLS.

<sup>\*</sup>This drawing is the property of CLA-VAL and same and copies made thereof, if any, shall be returned to it upon demand. Delivery and disclosure hereof are made solely upon condition that the same shall not be used, copied ore reproduced, nor shall the subject here of be disclosed in any manner to anyone for any purpose, except as herein authorized, without prior approval of CLA-VAL. Whether or not the equipment or information shown hereon is patented or otherwise protected, full title and copyrights if any, in and to this drawing and/or information delivered or submitted are fully reserved by CLA-VAL.



## 500 Series 316 SS Hytrol 100-44 and 100-46

Installing two-part flange

## Two-Piece Flange Design





- Easy Conversion from 150 Class to 300 Class
- Four identical half-flanges for each valve
- 316 Stainless Steel





## Two Half-Flanges Held Captive








- Flange studs and bolts hold valve flanges in place
- Textured side faces away from valve
- Smooth side faces toward valve



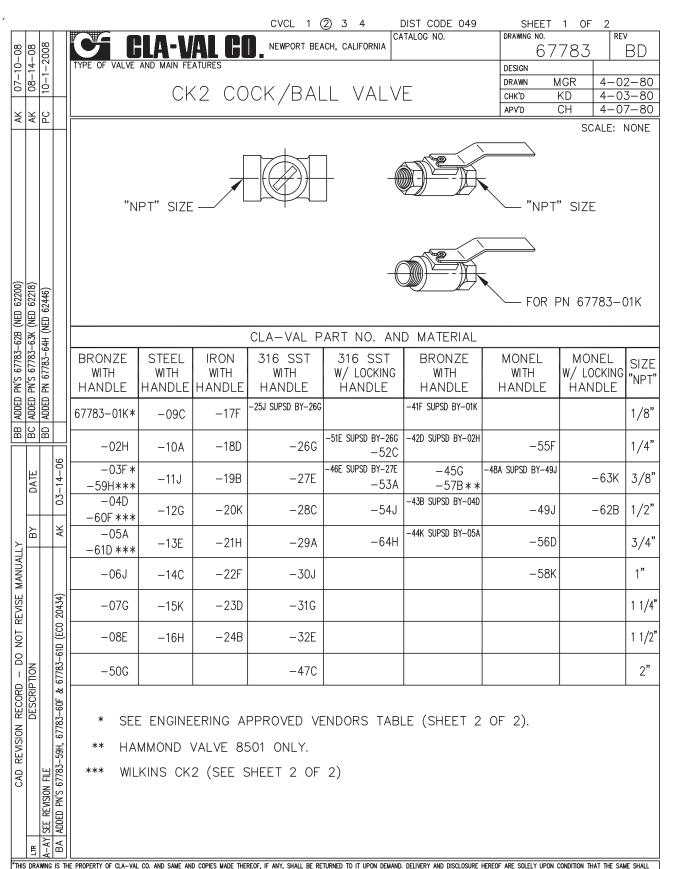

THIS DATAWNS IS THE PROPERTY OF COAP-VAL ON AND SAME AND COPIES MADE INEXEST, IF ANY, SHALL BE REIONAGE FOR DEBMAND, DELIVERY AND DISCUSSAR, REACH AND DISCUSSAR, PARES SOLELY OF VICANOMINE AND ANY MANER TO ANYONE FOR ANY PURPOSE, EXCEPT AS HEREIN AUTHORIZED, WITHOUT PRIOR WRITTEN APPROVAL OF CLA-VAL CO. THIS DRAWING IS SUBMITTED CONFIDENTIALLY AND MAY NOT BE USED IN THE MANUFACTURE OF ANY MATERIAL OR PRODUCT OTHER THAN SUCH MATERIALS AND PRODUCTS FURNISHED TO CLA-VAL CO. WHETHER OR NOT THE EQUIPMENT OR INFORMATION SHOWN HEREON IS PATENTED OR OTHERWISE PROTECTED, FULL TITLE AND COPYRIGHTS, IF ANY, IN AND TO THIS DRAWING AND/OR INFORMATION DELIVERED OR SUBMITTED ARE FULLY RESERVED CLA-VAL CO."




## -MODEL - CDC-1

## Check Valve (Sizes 3/8" and 1/2")




- **NSF 61 Approved**
- Meets low lead requirements
- · Soft Seat for Bubble Tight Shutoff, Spring Loaded for **Fast Seating Action**
- **Compact Design**
- Low Cracking Pressure 1/2 psi
- Flow Profile Designed to Minimize Head Loss
- Perfect Seating both at High and Low Pressure, Wide Temperature Range: +10° to 210°F
- · Polyethermide Disc to ensure the Best Resistance for **Corrosion and Abrasion**
- Patented Disc Guide to Prevent Any Side Loading



**Full Open Operation** 

Item	Description	Material
1	Body	Brass
2	End Connection	Brass
3	Disc	Polytherimide
4	Seat	NBR
5	Spring	Stainless Steel


Available only in replacement assembly.



**Tight Closing Operation** 

#### **Dimensions**

Size (NPT	Stock Number	A	В	С	Ι	СУ	psi	Wt.
3/8"	9834501A	1.73	0.79	1.06	0.40	4.55	400	0.37
1/2"	9834502J	2.32	0.98	1.35	0.53	6.00	400	0.32





## -MODEL-

#### Flow Control



#### **DESCRIPTION**

The Cla-Val Model CV Flow Control is a simply-designed, spring-loaded check valve. Rate of flow is full flow in one direction and restricted in other direction. Flow is adjustable in the restricted direction. It is intended for use in conjunction with a pilot control system on a Cla-Val Automatic Control Valve.

#### **OPERATION**

The CV Flow Control permits full flow from port A to B, and restricted flow in the reverse direction. Flow from port A to B lifts the disc from seat, permitting full flow. Flow in the reverse direction seats the disc, causing fluid to pass through the clearance between the stem and the disc. This clearance can be increased, thereby increasing the restricted flow, by screwing the stem out, or counter-clockwise. Turning the stem in, or clockwise reduces the clearance between the stem and the disc, thereby reducing the restricted flow.'

#### **INSTALLATION**

Install the CV Flow Control as shown in the valve schematic All connections must be tight to prevent leakage.

#### DISASSEMBLY

Follow the sequence of the item numbers assigned to the parts in the cross sectional illustration for recommended order of disassembly.

Use a scriber, or similar sharp-pointed tool to remove O-ring from the stem.

#### INSPECTION

Inspect all threads for damage or evidence of cross- threading. Check mating surface of seat and valve disc for excessive scoring or embedded foreign particles. Check spring for visible distortion, cracks and breaks. Inspect all parts for damage, corrosion and cleanliness.

#### **CLEANING**

After disassembly and inspection, cleaning of the parts can begin. Water service usually will produce mineral or lime deposits on metal parts in contact with water. These deposits can be cleaned by dipping the parts in a 5-percent muriatic acid solution just long enough for deposits to dissolve. This will remove most of the common types of deposits. Caution: use extreme care when handling acid. If the deposit is not removed by acid, then a fine grit (400) wet or dry sandpaper can be used with water. Rinse parts in water before handling. An appropriate solvent can clean parts used in fueling service. Dry with compressed air or a clean, lint-free cloth. Protect from damage and dust until reassembled.

#### REPAIR AND REPLACEMENT

Minor nicks and scratches may be polished out using a fine grade of emery or crocus cloth; replace parts if scratches cannot be removed.

Replace O-ring packing and gasket each time CV Flow Control is overhauled.

Replace all parts which are defective. Replace any parts which create the slightest doubt that they will not afford completely satisfactory operation. Use Inspection steps as a guide.

#### REASSEMBLY


Reassembly is the reverse of disassembly; no special tools are required.

#### **TEST PROCEDURE**

No testing of the flow Control is required prior to reassembly to the pilot control system on Cla-Val Main Valve.



# 3/8" Flow Control

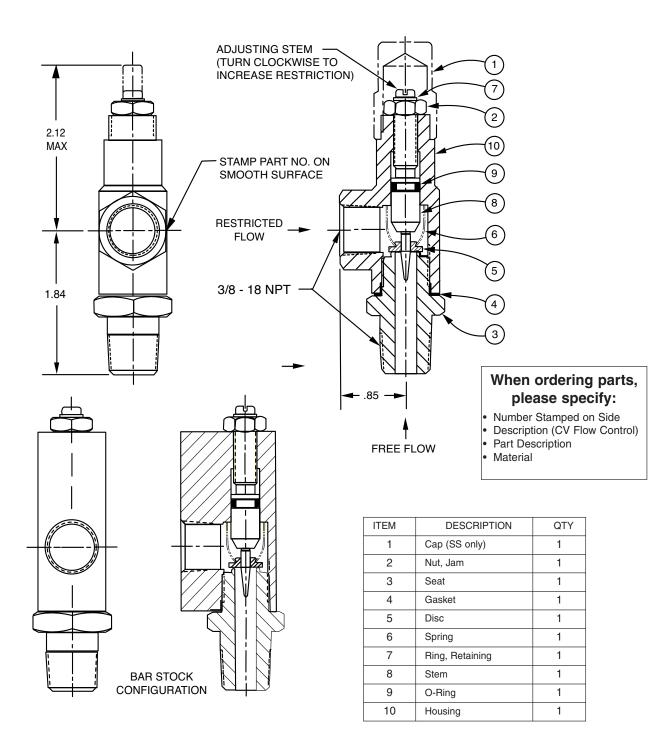



# Cla-Val Product Identification


### **How to Order**

#### **Proper Identification**


For ordering repair kits, replacement parts, or for inquiries concerning valve operation, it is important to properly identify Cla-Val products already in service by including all nameplate data with your inquiry. Pertinent product data includes valve function, size, material, pressure rating, end details, type of pilot controls used and control adjustment ranges.

#### **Identification Plates**


For product identification, cast-in body markings are supplemented by identification plates as illustrated on this page. The plates, depending on type and size of product, are mounted in the most practical position. It is extremely important that these identification plates are not painted over, removed, or in any other way rendered illegible.



This brass plate appears on altitude valves only and is found on top of the outlet flange.



This tag is affixed to the cover of the pilot control valve. The adjustment range appears in the spring range section.



This aluminum plate is included in pilot system modification kits and is to be wired to the new pilot control system after installation.



This brass plate appears on valves sized 2<sup>1</sup>/<sub>2</sub>" and larger and is located on the top of the inlet flange.




These two brass plates appear on <sup>3</sup>/<sub>8</sub>", <sup>1</sup>/<sub>2</sub>", and <sup>3</sup>/<sub>4</sub>" size valves and are located on the valve cover.



These two brass plates appear on threaded valves
1" through 3" size or flanged valves 1" through 2".
It is located on only one side of the valve body.



This brass plate is used to identify pilot control valves. The adjustment range is stamped into the plate.



This brass plate is used on our backflow prevention assemblies. It is located on the side of the Number Two check (2" through 10"). The serial number of the assembly is also stamped on the top of the inlet flange of the Number One check.



#### **HOW TO ORDER**

Because of the vast number of possible configurations and combinations available, many valves and controls are not shown in published product and price lists. For ordering information, price and availability on product that are not listed, please contact your local Cla-Val office or our factory office located at:

P. O. Box 1325 Newport Beach, California 92659-0325 (949) 722-4800 FAX (949) 548-5441

#### SPECIFY WHEN ORDERING

- Model Number
- · Globe or Angle Pattern
- Adjustment Range (As Applicable)
- · Valve Size
- Threaded or FlangedBody and Trim Materials
- Optional Features
- Pressure Class

#### UNLESS OTHERWISE SPECIFIED

- · Globe or angle pattern are the same price
- · Ductile iron body and bronze trim are standard
- X46 Flow Clean Strainer or X43 "Y" Strainer are included
- CK2 Isolation Valves are included in price on 4" and larger valve sizes (6" and larger on 600 Series)

#### LIMITED WARRANTY

Automatic valves and controls as manufactured by Cla-Val are warranted for three years from date of shipment against manufacturing defects in material and workmanship that develop in the service for which they are designed, provided the products are installed and used in accordance with all applicable instructions and limitations issued by Cla-Val. Electronic components manufactured by Cla-Val are warranted for one year from the date of shipment.

We will repair or replace defective material, free of charge, that is returned to our factory, transportation charges prepaid, if upon inspection, the material is found to have been defective at time of original shipment. This warranty is expressly conditioned on the purchaser's providing written notification to Cla-Val immediate upon discovery of the defect.

Components used by Cla-Val but manufactured by others, are warranted only to the extent of that manufacturer's guarantee.

This warranty shall not apply if the product has been altered or repaired by others, Cla-Val shall make no allowance or credit for such repairs or alterations unless authorized in writing by Cla-Val.

### DISCLAIMER OF WARRANTIES AND LIMITATIONS OF LIABILITY

The foregoing warranty is exclusive and in lieu of all other warranties and representations, whether expressed, implied, oral or written, including but not limited to any implied warranties or merchantability or fitness for a particular purpose. All such other warranties and representations are hereby cancelled.

Cla-Val shall not be liable for any incidental or consequential loss, damage or expense arising directly or indirectly from the use of the product. Cla-Val shall not be liable for any damages or charges for labor or expense in making repairs or adjustments to the product. Cla-Val shall not be liable for any damages or charges sustained in the adaptation or use of its engineering data and services. No representative of Cla-Val may change any of the foregoing or assume any additional liability or responsibility in connection with the product. The liability of Cla-Val is limited to material replacements F.O.B. Newport Beach, California.

#### **TERMS OF SALE**

#### ACCEPTANCE OF ORDERS

All orders are subject to acceptance by our main office at Newport Beach, California.

#### **CREDIT TERMS**

Credit terms are net thirty (30) days from date of invoice.

#### PURCHASE ORDER FORMS

Orders submitted on customer's own purchase order forms will be accepted only with the express understanding that no statements, clauses, or conditions contained in said order form will be binding on the Seller if they in any way modify the Seller's own terms and conditions of sales.

#### PRODUCT CHANGES

The right is reserved to make changes in pattern, design or materials when deemed necessary, without prior notice.

#### PRICES

All prices are F.O.B. Newport Beach, California unless expressly stated otherwise on our acknowledgement of the order. Prices are subject to change without notice. The prices at which any order is accepted are subject to adjustment to the Seller's price in effect at the time of shipment. Prices do not include sales, excise, municipal, state or any other Government taxes. Minimum order charge \$100.00.

#### RESPONSIBILITY

We will not be responsible for delays resulting from strikes, accidents, negligence of carriers, or other causes beyond our control. Also, we will not be liable for any unauthorized product alterations or charges accruing there from.

#### RISK

All goods are shipped at the risk of the purchaser after they have been delivered by us to the carrier. Claims for error, shortages, etc., must be made upon receipt of goods.

#### **EXPORT SHIPMENTS**

Export shipments are subject to an additional charge for export packing.

#### RETURNED GOODS

- Customers must obtain written approval from Cla-Val prior to returning any material.
- 2. Cla-Val reserves the right to refuse the return of any products.
- 3. Products more than six (6) months old cannot be returned for credit.
- 4. Specially produced, non-standard models cannot be returned for credit.
- Rubber goods such as diaphragms, discs, o-rings, etc., cannot be returned for credit, unless as part of an unopened vacuum sealed repair kit which is less than six months old.
- Goods authorized for return are subject to a 35% (\$100 minimum) restocking charge and a service charge for inspection, reconditioning, replacement of rubber parts, retesting, repainting and repackaging as required.
- Authorized returned goods must be packaged and shipped prepaid to Cla-Val, 1701 Placentia Avenue, Costa Mesa, California 92627.



#### **CLA-VAL**

PO Box 1325 Newport Beach CA 92659-0325 Phone: 949-722-4800 • Fax: 949-548-5441

#### CLA-VAL CANADA 4687 Christie Drive

Beamsville, Ontario
Canada L0R 1B4
Phone: 905-563-4963
Fax: 905-563-4040

COPYRIGHT CLA-VAL 2011 Printed in USA
Specifications subject to change without notice.

#### **CLA-VAL EUROPE**

Chemin dés Mesanges 1 CH-1032 Romanel/ Lausanne, Switzerland Phone: 41-21-643-15-55 Fax: 41-21-643-15-50

www.cla-val.com

Represented By:



## - MODEL - REPAIR KITS

Complete Replacement Diaphragm Assemblies for 100-01 and 100-20 Hytrol Main Valves *For:* Hytrol Main Valves with Ductile Iron, Bronze Trim Materials—125/150 Pressure Class Only. FACTORY ASSEMBLED

Includes: Stem, Disc Guide, Disc, Disc Retainer, Spacer Washers, Diaphragm, Diaphragm Washer and Stem Nut.

Valve Size		Diaphragm Assembly Stock Number 100-01 100-20		Valve Size	Diaphragm Assembly Stock Number	
3126				3126	100-01	100-20
3/8"	(Also 81-01)	49097K	N/A	6"	40456G	33273E
1/2" - 3/4"	(Also 81-01)	C2518D	N/A	8"	45276D	40456G
1"	,	C2520K	N/A	10"	81752J	45276D
1 1/4"-1 1/2"		C2522 F	N/A	12"	85533J	81752J
2"		C2524B	N/A	14"	89067D	N/A
2 1/2"		C2523D	N/A	16"	89068B	85533J
3"		C2525J	C2524B	20"	N/A	89068B
4"		33273E	C2525J	24"	N/A	89068B

#### Repair Kits for 100-01/100-20 Hytrol Valves

For: Hytrol Main Valves—125/150 Pressure Class Only.

Includes: Diaphragm, Disc (or Disc Assembly) and spare Spacer Washers.

E	Buna-N <sup>®</sup> Star	ndard Mate	rial	Viton (For KB Valves)			
Valve		Repair Kit		Valve		Repair Kit	
Size		Stock Number		Size		Stock Number	
		100-01	100-20			100-01	100-20
3/8"	(Also 81-01)	9169801K	N/A	3/8"	(Also 81-01)	9169806J	N/A
1/2" - 3/4"	(Also 81-01)	9169802H	N/A	1/2" - 3/4"	(Also 81-01)	9169807G	N/A
1"		9169803F	N/A	1"		9169808E	N/A
1 1/4" - 1 1/2"		9169804D	N/A	1 1/4" - 1 1/2"		9169809C	N/A
2"		9169805A	N/A	2"		9169810A	N/A
2 1/2"		9169811J	N/A	2 1/2"		9169817F	N/A
3"		9169812G	9169805A	3"		9169818D	9169810A
4"		9169813E	9169812G	4"		9169819B	9169818D
6"		9169815K	9169813E	6"		9169820K	9169819B
8"		9817901D	9169815K	8"		9169834A	9169820K
10"		9817902B	9817901D				
12"		9817903K	9817902B				
14"		9817904H	N/A				
16"		9817905E	9817903K				
20"		N/A	9817905E				
24"		9817906C	9817905E				

When ordering, please give complete nameplate data of the valve and/or control being repaired.

MINIMUM ORDER CHARGE APPLIES.

#### Repair Kits for 100-02/100-21 Powertrol and 100-03/100-22 Powercheck Main Valves

For: Powertrol and Powercheck Main Valves—125/150 Pressure Class Only

Includes: Diaphragm, Disc (or Disc Assembly) and O-rings and full set of spare Spacer Washers.

Valve	Kit Stock Number	Valve	Kit Stoc	k Number
Size	100-02	Size	100-02 & 100-03	100-21 & 100-22
3/8"	9169901H	2½"	9169910J	N/A
1/2" & 3/4"	9169902F	3"	9169911G	9169905J
1"	9169903D	4"	9169912E	9169911G
1¼" & 1½"	9169904B	6"	9169913C	9169912E
2"	9169905J	8"	99116G	9169913C
		10"	9169939H	99116G
		12"	9169937B	9169939H

#### Repair Kits for 100-04/100-23 Hy-Check Main Valves

For: Hy-Check Main Valves—125/150 Pressure Class Only

Includes: Diaphragm, Disc and O-Rings and full set of spare Spacer Washers.

Larger Sizes: Consult Factory.

Larger Sizes: Consult Factory.

Valve	Kit Stock Number		Valve	Kit Stock Number	
Size	100-04	100-23	Size	100-04	100-23
4"	20210901B	N/A	12"	20210905H	20210904J
6"	20210902A	20210901B	14"	20210906G	N/A
8"	20210903K	20210902A	16"	20210907F	20210905H
10"	20210904J	20210903K	20"	N/A	20210907F
			24"	N/A	20210907F

#### Repair Kits for Pilot Control Valves (In Standard Materials Only)

Includes: Diaphragm, Disc (or Disc Assembly), O-Rings, Gaskets or spare Screws as appropriate.

	<b>BUNA-N</b> ® (St	VITON (For KB Controls)			
Pilot Control	Kit Stock Number	Pilot Control	Kit Stock Number	Pilot Control	Kit Stock Number
CDB	9170006C	CFM-7	1263901K	CDB-KB	9170012A
CDB-30	9170023H	CFM-7A	1263901K	CRA-KB	N/A
CDB-31	9170024F	CFM-9	12223E	CRD-KB (w/bucking spring)	9170008J
CDB-7	9170017K	CRA (w/bucking spring)	9170001D	CRL-KB	9170013J
CDH-2	18225D	CRD (w/bucking spring)	9170002B	CDHS-2BKB	9170010E
CDHS-2	44607A	CRD (no bucking spring)	9170003K	CDHS-2FKB	91700110
CDHS-2B	9170004H	CRD-18	20275401K	CDHS-18KB (no bucking spring)	91700090
CDHS-2F	9170005E	CRD-22	98923G	102C-KB	1726202
CDHS-3C-A2	24657K	CRL (55F, 55L)	9170007A		
CDHS-8A	2666901A	CRL-4A	43413E		
CDHS-18	9170003K	CRL-5 (55B)	65755B		
CDS-4	9170014G	CRL-5A (55G)	20666E		
CDS-5	14200A	CRL-18	20309801C		
CDS-6	20119301A	CV	9170019F		
CDS-6A	20349401C	X105L (O-ring)	00951E	Buna-N <sup>®</sup>	
CFCM-M1	1222301C	102B-1	1502201F	CRD Disc Ret. (Solid)	C5256H
CFM-2	12223E	102C-2	1726201F	CRD Disc Ret. (Spring)	C5255K
		102C-3	1726201F		

#### Repair Assemblies (In Standard Materials Only)

Control	Description	Stock Number
CF1-C1	Pilot Assembly Only	89541H
CF1-CI	Complete Float Control less Ball and Rod	89016A
CFC2-C1	Disc, Distributor and Seals	2674701E
CSM 11-A2-2	Mechanical Parts Assembly	97544B
CSM 11-A2-2	Pilot Assembly Only	18053K
33A 1"	Complete Internal Assembly and Seal	2036030B
33A 2"	Complete Internal Assembly and Seal	2040830J

When ordering, please give complete nameplate data of the valve and/or control being repaired. MINIMUM ORDER CHARGE APPLIES